



VEEDER-ROOT INSTALLATION INSTRUCTIONS

Technical Manual
Issued: 6/00
Supersedes: 9/96

BASEEFA 7671 PULSE TRANSMITTER

Manual No. 251849, Rev. D

1. DESCRIPTION

A. GENERAL. These instructions are for installation of the BASEEFA 7671 Solid State Pulse Transmitter, Figure 1, designed and manufactured by Veeder-Root Company, 6th Avenue at Burns Crossing, P.O.Box 1673, Altoona, PA 16603, USA, (814) 695-4476.

These solid state pulse transmitters provide fast and accurate signaling for remote indication, totalizing and data monitoring systems. They are BASEEFA certified for gasoline pump computers and applications that require monitoring of output shaft rotation in hazardous locations. CE compliance per Emc directive 89/336.

The output can be either dual channel with 50 pulses per revolution per channel or single channel with 100 pulses per revolution. The dual channel pulse trains can be staggered or overlapping. A staggered output allows errors to be detected on either channel or on both concurrently (power loss to pulser). An overlapping (quadrature) output permits the detection of direction of rotation and errors on either channel but not both concurrently. The single channel devices are used when greater pulse density is desired and error detection is not required.

2. SPECIFICATIONS

Specifications listed are standard unless otherwise noted. Optional features are available at additional cost.

Recommended Operating Conditions (each channel):

Power Requirement: 10 to 15 VDC; 50 mA (max.) at 15 VDC.

Output Voltage: Dependent on load. See Figure 2.

Switching Times: Rise Time: 2 microseconds maximum with 10 mA resistive load to ground. Fall time: 4 microseconds maximum.

Rotation: Standard is bidirectional. Optional models available with no-back feature.

Input Shaft Speed: 600 rpm maximum.

Torque: 2 oz-in. maximum (144 g-cm).


Output Pulse: Dual channel at 50 ppr, staggered or overlapping (quadrature). Single channel at 100 ppr. See Figure 2.

Duty Cycle:

Overlapping/Quadrature: 50% ±10% high/low ratio. Second channel phase displaced by 90° ±18°.

Staggered: 75% ±5% high/low ratio. Second channel displaced by 180° ±18°.

Single Channel: 50% ±10% high/low ratio.

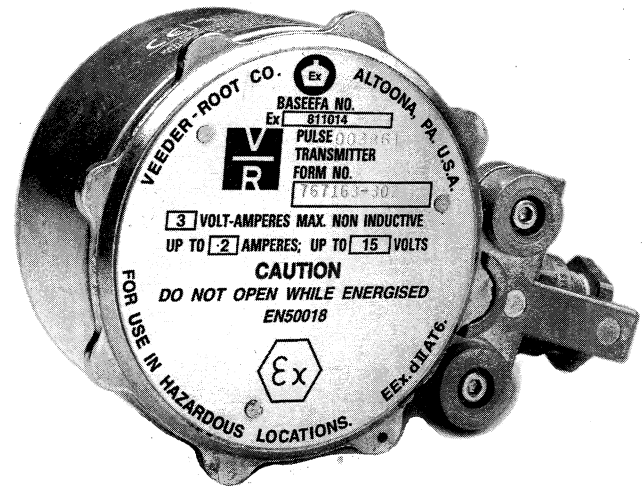

Operating Environment: -40° to +82°C (-40° to +180°F).

Storage Environment: -55° to +125°C (-67° to +257°F).

Shaft: Specify length of either 10.4 or 16.5 mm (0.410 or 0.650 inch).

Shock: Normal shipping.

Housing: Explosion-proof.

Mounting: Three ¼-20 NC-2 blind tapped holes, spaced 120° apart on a 63.5 mm (2.5") diameter bolt circle.

Models 7671xx-xxx*	Bidirectional	Clockwise	Counter-clockwise
Dual Channel (overlap)	-30x	-40x	-50x
Dual Channel (staggered)	-31x	-41x	-51x
Single Channel	-32x	-42x	-52x

*Third digit of the suffix number indicates length of shaft. Contact factory for details.

Note: Consult Veeder-Root on any unusual application, installation, or possible modification of this basic design.

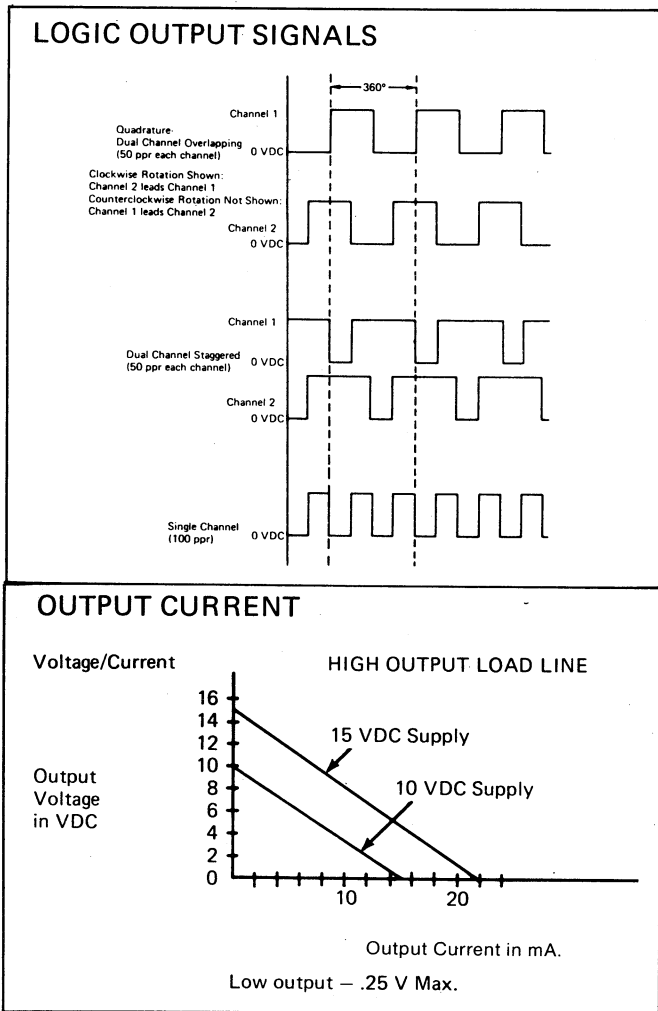


Figure 2. Output Signal and Current.

3. INSTALLATION

WARNING: IN INSTALLATION AND USE OF THIS PRODUCT, COMPLY WITH THE ELECTRICAL CODE AND/OR ANY OTHER APPLICABLE SAFETY CODES. IN ADDITION, DISCONNECT POWER AND TAKE OTHER NECESSARY PRECAUTIONS TO PREVENT PERSONAL INJURY AND EQUIPMENT DAMAGE DURING INSTALLATION AND SERVICE.

A. GENERAL. Proper installation is necessary if this pulse transmitter is to provide satisfactory operation. Improper installation will result in damage from any of the following conditions:

1. Connecting reverse supply voltage.
2. Connecting pulser signal output to power supply positive.
3. Exceeding temperature range: -40° to $+82^{\circ}\text{C}$ (-40° to $+180^{\circ}\text{F}$) while operating.
4. Operating the unit in excess of 600 rpm.

Conditions 1 and 2 above cause irreversible damage almost instantaneously. Excessive heat causes permanent damage whether or not the unit is in use. Excessive cold prevents the unit from functioning, but it will recover when normal temperature is restored.

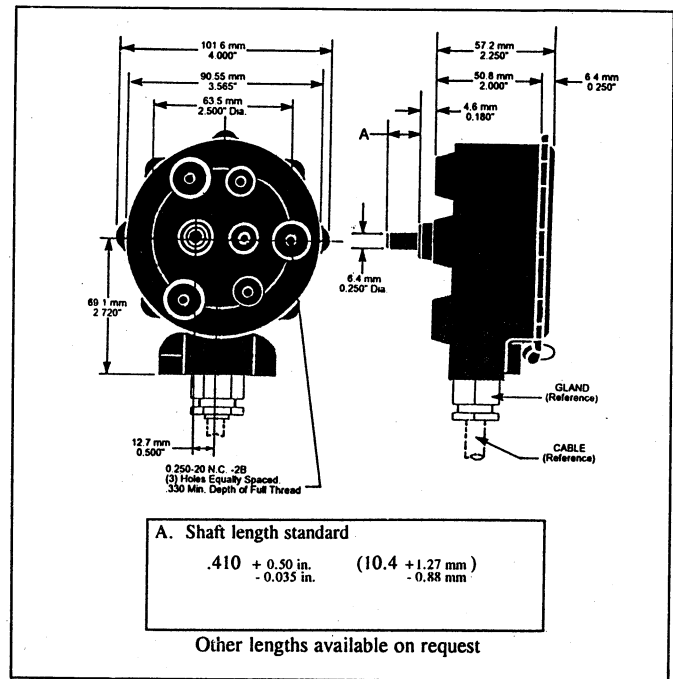


Figure 3. Mounting Dimensions.

B. MOUNTING.

1. Installation may be made in almost any environment free from severe vibration and extreme temperature.
2. Three equally spaced holes, 0.250-20 NC-2B, on the back of the case are provided for mounting (see Figure 3). Brackets and mounting arrangements must be sufficient to maintain alignment and minimize side load on shaft bearings.
3. Shaft coupling method shall be determined by the user. Drive shaft diameter is 0.25 inch (6.35 mm).

C. WIRING. See Figure 4 for output and operating voltage connections for Dual Output Models. See Figure 5 for output and operating voltage connections for Single Output Models. See Figure 6 for terminal block circuit connections.

A complete schematic is shown in Figure 7.

D. OPERATING CHECK. After installation and before normal use, check pulse transmitter and related circuitry for proper installation and operation.

CAUTION: BE SURE ALL WIRES ARE INSTALLED CORRECTLY BEFORE TURNING ON THE POWER SINCE FAULTY INSTALLATION CAN DAMAGE THIS UNIT.

1. Inspect all leads, connections, and ground. Be sure all external circuits are wired correctly.
2. Check for correct pulse transmission:
 - a. Turn on power.
 - b. Rotate shaft a specific number of turns.
 - c. Related equipment must confirm the number of pulses transmitted.
 - d. Turn off power.
3. Reexamine the installation to be certain all safety measures have been met and adequate protection is provided against possible damage. The system may be operated normally only after all the preceding checks have been performed and all corrections made.

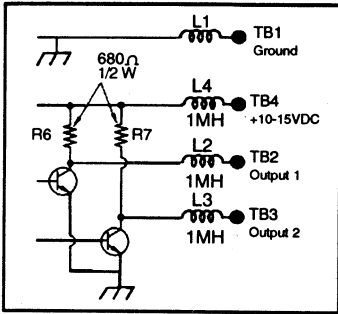


Figure 4. Wiring Connections for Dual Output Models.

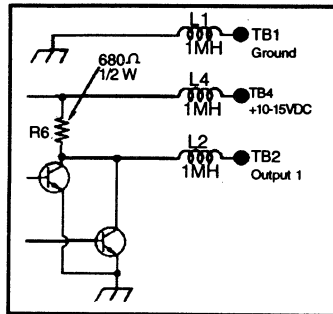


Figure 5. Wiring Connections for Single Output Models.

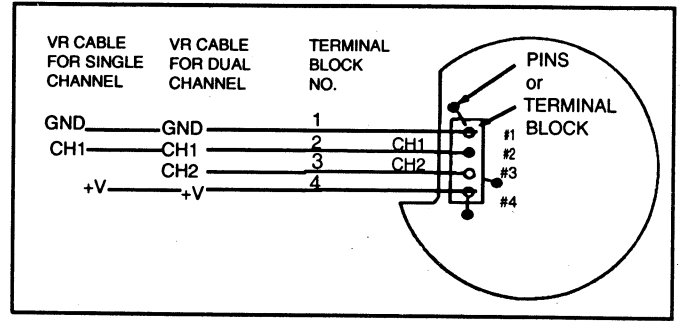


Figure 6. Terminal Block Circuit Connections.

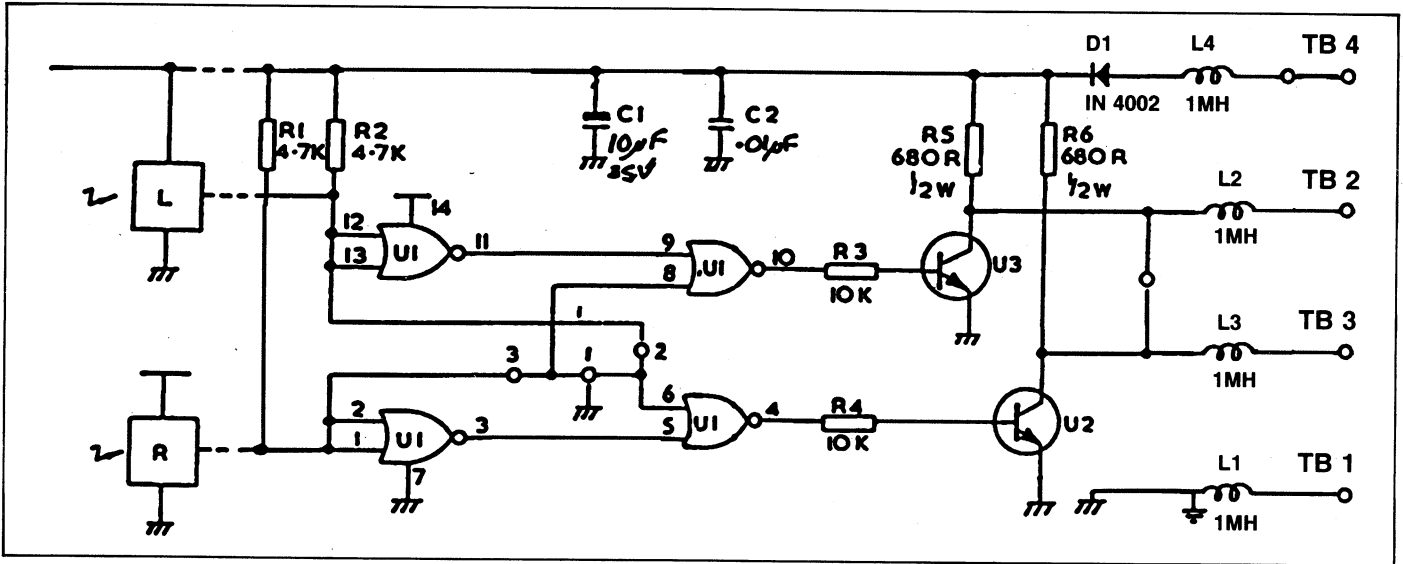


Figure 7. Schematic.

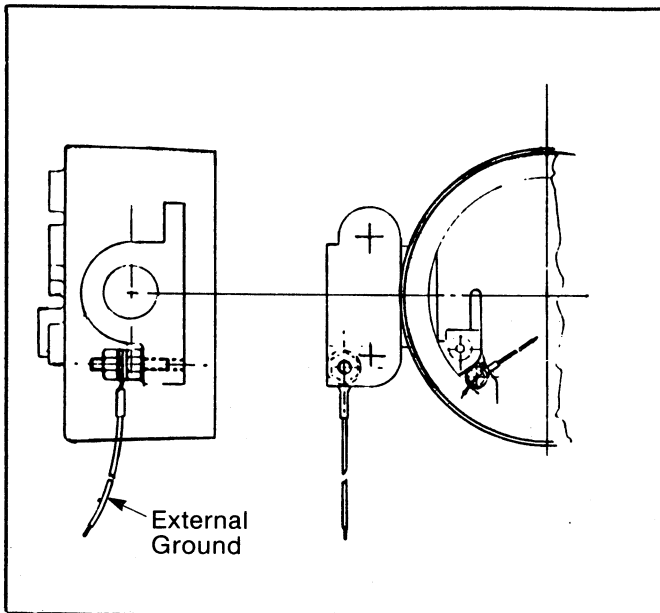


Figure 8. External Ground Wire.

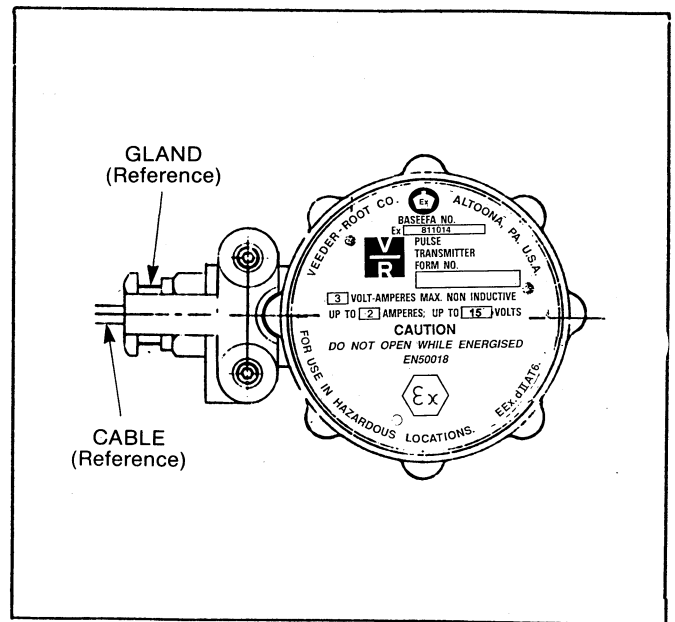


Figure 9. Cable Gland.

4. EXTERNAL WIRING NOTES

1. Customer applied ground wire is shown in Figure 8.
2. Any cable gland approved by BASEEFA for use with Group IIA, IIB, or IIC enclosures may be used.
3. 2, 3, 4, 5, or 6 core tinned copper conductors recommended with metallic screen. All enclosed in an outer insulating sheath.

4. Should product be exposed within systems in areas where radiated fields are greater than 3 v/m, possible error in pulse count may occur.
5. The internal earth point screw must not exceed 4mm in length.

5. SERVICE NOTES

A. REPAIR. It is NOT recommended that attempts to repair the pulse transmitter be made by users or their agents. The compact design of the pulse transmitter, made possible by the use of solid state devices, makes special knowledge and unique test equipment essential if serious damage to the electronic circuits is to be avoided. We therefore recommend that the pulse transmitter be returned to Veeder-Root for repair or adjustment.

B. SHIPMENT. If the pulse transmitter must be returned to Veeder-Root for repair, perform the following steps:

1. Explain, in writing, the nature of the malfunction as accurately as possible. List the persons to be contacted in the event communication is required.
2. Place the letter along with the pulse transmitter and its packing material in its box.

3. Place in an overwrap box. Address to:
Veeder-Root Co.
6th Avenue at Burns Crossing
P.O. Box 1673
Altoona, PA 16603*

* If not using P.O. Box for address, the Zip code is 16602.

4. All shipments must be prepaid.

6. CLAIMS AND WARRANTY

A. DAMAGE CLAIMS

1. Thoroughly examine all components and units as soon as received. If damaged, write on the face of the freight bill a complete and detailed description of the damage. Have the carrier's agent sign the description.

Note: Insist that the carrier's agent verify the inspection and sign the description.

2. Immediately notify the delivering carrier of damage or loss. This notification may be given either in person or by telephone. Written confirmation must be mailed within 48 hours. Railroads and motor carriers are understandably reluctant to make adjustments for damaged merchandise unless inspected and reported promptly.

3. Risk of loss of, or damage to merchandise remains with the Buyer. It is the Buyer's responsibility to file a claim with the carrier involved.

4. Immediately advise your Veeder-Root representative, distributor, or the factory so that we may assist you.

B. WARRANTY AND CONDITIONS

1. WARRANTY. We warrant that our products shall be free from defects in material and workmanship for a period of one year from the date of shipment thereof or the product's total rated life, whichever first occurs. Within the warranty period we shall repair or replace such products which are returned to us with shipping charges prepaid and which are determined by us to be defective. This warranty will not apply to any produce which has been subjected to misuse, negligence, or accident; or misapplied; or used in violation of product manuals, instructions, or warnings; or modified or repaired by unauthorized persons; or improperly installed.

2. INSPECTION. You shall inspect the product promptly after receipt and shall notify us at our Altoona office, in writing, of any claims, including claims of breach of warranty, within thirty days after you discover or should have discovered the facts upon which the claim is based. Your failure to give written notice of a claim within the time period shall be deemed to be a waiver of such claim.

3. LIMITATION OF REMEDY AND WARRANTY. The provisions of Paragraph 1 are our sole obligation and exclude all other remedies or warranties, express or implied, including warranties of MERCHANTABILITY and FITNESS FOR A PARTICULAR PURPOSE, whether or not purposes or specifications are described herein. We further disclaim any responsibility whatsoever to you or to any other person for injury to person or damage to or loss of property or value caused by any product which has been subjected to misuse, negligence, or accident; or misapplied; or used in violation of product manuals, instructions, or warnings; or modified or repaired by unauthorized persons; or improperly installed.

4. LIMITATIONS OF DAMAGES. Under no circumstances shall we be liable for any incidental, cosequential or special damages, losses or expences arising from this contract or its performance or in connection with the use of, or inability to use, our product for any puporse whatsoever.

5. LIMITATION OF ACTIONS. No action regardless of form arising out of this contract may be commenced more than one year after the cause of action has accrued, except an action for nonpayment.

6. COLLATERAL PROMISES. There are no representations, warranties, or condtions express or implied, statutory or otherwise except those herein contained, and no agreements or waivers collateral hereto shall be binding on either party unless in writing and signed by you and accepted by us at our Altoona office.

7. INTERPRETATION. Rights and liabilities arising out of any contract with us shall be determined under the Uniform Commercial Code as enacted in Connecticut.

